

Cs-134	Cs-137	H-3	全 α (gross α)	全 β ^{※3} (gross β)	Sr-90	Pu-238	Pu-239+240
放射性物質濃度 (検出下限値) (Bq/L) (ND ^{※2} : 不検出) Radioactivity concentration (Lower detection limit) (Bq/L) (ND ^{※2} : Not Detectable)							

T-5	2021/3/1 8:12	ND(0.0014) ND(0.0013)	0.0026 0.0020	ND(0.28)	ND(1.8)	ND(13)	ND(0.00075)			O L	
	2021/3/9 7:40	ND(0.0014) ND(0.0013)	0.0030 0.0028							O L	
	2021/3/15 8:23	ND(0.0012) ND(0.0013)	0.0027 0.0033	ND(0.29)		ND(15)				O L	
	2021/3/23 7:09	ND(0.0014) ND(0.0010)	0.0022 0.0021							O L	
	2021/4/1 8:43	ND(0.0011) ND(0.0014)	0.0036 0.0030	ND(0.31)	ND(1.9)	ND(15)	ND(0.00071)			O L	
	採取中止(No samples)										
	2021/4/12 7:06	ND(0.0014) ND(0.0010)	0.0028 0.0028	ND(0.32)		ND(14)		ND(0.0000078)	ND(0.0000074)		O L
	2021/4/21 7:19	ND(0.0010) ND(0.0012)	0.0015 0.0025								O L
	2021/4/27 7:05	ND(0.0014) ND(0.0013)	0.0017 0.0023								O L
	2021/5/6 7:11	ND(0.0014) ND(0.0010)	0.0017 0.0023	ND(0.32)	ND(1.8)	17	ND(0.00078)				O L
	2021/5/10 7:08	ND(0.0014) ND(0.0014)	0.0028 0.0020								O L
	2021/5/20 7:09	ND(0.0012) ND(0.0012)	0.0022 0.0014	ND(0.32)		ND(13)					O L
	2021/5/24 8:16	ND(0.0013) ND(0.0014)	0.0024 0.0019								O L
	2021/6/1 8:36	ND(0.0011) ND(0.0012)	0.0033 0.0018	ND(0.30)		ND(14)					O L
	2021/6/7 7:15	ND(0.0013) ND(0.0012)	0.0029 0.0028								O L
	2021/6/14 7:06	ND(0.0012) ND(0.0012)	0.0024 0.0022								O L
	T-D1	2021/3/1 8:05	ND(0.0012) ND(0.0014)	0.0069 0.0079	ND(0.31)	ND(2.2)	16	0.0011			O L
		2021/3/8 7:52	ND(0.0011) ND(0.0013)	0.0049 0.0043							O L
		2021/3/15 7:59	ND(0.0012) ND(0.0012)	0.0031 0.0041	ND(0.29)		ND(15)				O L
		2021/3/24 7:55	ND(0.0013) ND(0.0014)	0.0037 0.0042							O L
2021/4/1 8:09		ND(0.0012) ND(0.0013)	0.0036 0.0049	ND(0.29)	ND(1.9)	ND(15)	ND(0.00069)			O L	
2021/4/8 7:41		ND(0.0013) ND(0.0013)	0.0030 0.0051					ND(0.0000058)	ND(0.0000060)	O L	
2021/4/12 7:45		ND(0.0010) ND(0.0011)	0.0037 0.0046	ND(0.32)		ND(14)				O L	
2021/4/20 7:42		ND(0.0011) ND(0.0013)	0.0088 0.0082							O L	
2021/4/27 7:39		ND(0.0012) ND(0.0012)	0.0036 0.0064							O L	
2021/5/6 8:01		ND(0.0014) ND(0.0011)	0.0073 0.0088	ND(0.29)	ND(1.8)	ND(13)	ND(0.00062)			O L	
2021/5/10 7:48		ND(0.0012) ND(0.0014)	0.0042 0.0056							O L	
2021/5/19 7:58		ND(0.0012) ND(0.0013)	0.0038 0.0083	ND(0.29)		15				O L	
2021/5/24 7:54		ND(0.0010) ND(0.0010)	0.0048 0.0049							O L	
2021/6/1 7:53		ND(0.0012) ND(0.0010)	0.0032 0.0058	ND(0.30)		ND(14)				O L	
2021/6/7 7:40		ND(0.0014) ND(0.0011)	0.0051 0.0094							O L	
2021/6/14 7:45		ND(0.0010) ND(0.0012)	0.0033 0.0033							O L	

O: 上層 (表層~2m) Outer Layer
L: 下層 (海底より2~3m上) Lower Layer

Cs-134	Cs-137	H-3	全 α (gross α)	全 β^{*3} (gross β)	Sr-90	Pu-238	Pu-239+240
放射性物質濃度 (検出下限値) (Bq/L) (ND※2: 不検出) Radioactivity concentration (Lower detection limit) (Bq/L) (ND※2: Not Detectable)							

T-D5	2021/3/1 8:40	ND(0.0014) ND(0.0014)	0.0039 0.0033	ND(0.31)	ND(2.2)	16	0.0011		O L
	2021/3/8 8:15	ND(0.0011) ND(0.0013)	0.0040 0.0062						O L
	2021/3/15 8:27	ND(0.0013) ND(0.0014)	0.0069 0.0042	ND(0.29)		ND(15)			O L
	2021/3/24 8:23	ND(0.0013) ND(0.0014)	0.0045 0.0049						O L
	2021/4/1 8:45	ND(0.0013) ND(0.0014)	0.0064 0.0048	ND(0.28)	ND(1.9)	ND(15)	0.00092		O L
	2021/4/8 8:10	ND(0.0013) ND(0.0014)	0.0041 0.0070				ND(0.0000063)	0.0000066	O L
	2021/4/12 8:11	ND(0.0011) ND(0.0012)	0.0051 0.0032	ND(0.32)		ND(14)			O L
	2021/4/20 8:04	ND(0.0012) ND(0.0013)	0.0065 0.0046						O L
	2021/4/27 8:05	ND(0.0014) ND(0.0012)	0.0051 0.0050						O L
	2021/5/6 8:40	ND(0.0012) ND(0.0012)	0.0074 0.0035	0.33	ND(1.8)	ND(13)	0.00064		O L
	2021/5/10 8:12	ND(0.0014) ND(0.0011)	0.0042 0.0045						O L
	2021/5/19 8:25	ND(0.0012) ND(0.0014)	0.0049 0.0091	0.35		ND(12)			O L
	2021/5/24 8:21	ND(0.0012) ND(0.0012)	0.0036 0.0042						O L
	2021/6/1 8:23	ND(0.0011) ND(0.0010)	0.0057 0.0072	ND(0.30)		ND(14)			O L
	2021/6/7 8:04	ND(0.0011) ND(0.0011)	0.011 0.010						O L
	2021/6/14 8:09	ND(0.0013) ND(0.0014)	0.0038 0.0034						O L

T-D9	2021/3/1 9:21	ND(0.0013) ND(0.0012)	0.0034 0.0040	ND(0.27)	ND(1.8)	16	0.0014		O L	
	2021/3/9 8:36	ND(0.0012) ND(0.0013)	0.0040 0.0057						O L	
	2021/3/15 10:15	ND(0.0011) ND(0.0014)	0.0049 0.0037	ND(0.29)		ND(15)			O L	
	2021/3/23 7:57	ND(0.0012) ND(0.0013)	0.0095 0.0083						O L	
	2021/4/1 7:59	ND(0.0012) ND(0.0013)	0.0069 0.0079	ND(0.31)	ND(1.9)	ND(15)	ND(0.00072)		O L	
	採取中止(No samples)									
	2021/4/12 8:02	ND(0.0012) ND(0.0013)	0.0062 0.0044	ND(0.32)		ND(14)		ND(0.0000075)	ND(0.0000079)	O L
	2021/4/21 8:05	ND(0.0013) ND(0.0012)	0.0035 0.0039							O L
	2021/4/27 7:54	ND(0.0012) ND(0.0013)	0.0064 0.0056							O L
	2021/5/6 8:08	ND(0.0012) ND(0.0013)	0.0061 0.0027	0.44	ND(1.8)	ND(13)	0.0012			O L
	2021/5/10 8:05	ND(0.0014) ND(0.0011)	0.0043 0.0056							O L
	2021/5/20 7:58	ND(0.0012) ND(0.0012)	0.0038 0.011	ND(0.32)		ND(13)				O L
	2021/5/24 9:24	ND(0.0013) ND(0.0013)	0.0064 0.0057							O L
	2021/6/1 9:47	ND(0.00098) ND(0.0010)	0.0044 0.0050	ND(0.30)		ND(14)				O L
	2021/6/7 8:00	ND(0.0013) ND(0.0014)	0.0032 0.0069							O L
	2021/6/14 7:56	ND(0.0011) ND(0.0012)	0.0048 0.0035							O L

O: 上層(表層~2m) Outer Layer
 L: 下層(海底より2~3m上) Lower Layer

Cs-134	Cs-137
--------	--------


放射性物質濃度 (検出下限値) (Bq/L) (ND※2: 不検出)
Radioactivity concentration (Lower detection limit) (Bq/L) (ND※2: Not Detectable)

T-11	2021/3/1 10:11	ND(0.00099)	0.0031	O	
		ND(0.0012)	0.0035	L	
	2021/3/9 9:06	ND(0.0013)	0.0068	O	
		ND(0.0014)	0.012	L	
	2021/3/15 10:42	ND(0.0014)	0.019	O	
		ND(0.0013)	0.0058	L	
	2021/3/23 8:24	ND(0.0013)	0.012	O	
		ND(0.0013)	0.014	L	
	2021/4/1 7:14	ND(0.00097)	0.0094	O	
		ND(0.0012)	0.011	L	
	採取中止(No samples)				O
	2021/4/12 8:35	ND(0.0012)	0.0054	O	
		ND(0.0014)	0.0045	L	
	2021/4/21 8:35	ND(0.0011)	0.0058	O	
		ND(0.0012)	0.0050	L	
	2021/4/27 8:21	ND(0.0013)	0.0034	O	
		ND(0.0014)	0.017	L	
	2021/5/6 8:44	ND(0.0012)	0.0052	O	
		ND(0.0012)	0.0029	L	
	2021/5/10 8:45	ND(0.00099)	0.0044	O	
		ND(0.0012)	0.0046	L	
	2021/5/20 8:29	ND(0.0013)	0.0099	O	
		ND(0.0014)	0.0078	L	
	2021/5/24 10:06	ND(0.0014)	0.0070	O	
		ND(0.0013)	0.0048	L	
	2021/6/1 10:30	ND(0.0012)	0.0037	O	
		ND(0.0011)	0.0061	L	
	2021/6/7 8:26	ND(0.0013)	0.0064	O	
ND(0.0013)		0.017	L		
2021/6/14 8:24	ND(0.0013)	0.0049	O		
	ND(0.0014)	0.0039	L		

T-14	2021/3/1 7:39	ND(0.0014)	0.0070	O
		ND(0.0017)	0.020	L
	2021/3/8 7:33	ND(0.0014)	0.0030	O
		ND(0.0014)	0.0038	L
	2021/3/15 7:39	ND(0.0013)	0.0042	O
		ND(0.0013)	0.0035	L
	2021/3/24 7:34	ND(0.0014)	0.0039	O
		ND(0.0015)	0.0039	L
	2021/4/1 7:45	ND(0.0013)	0.0029	O
		ND(0.0012)	0.0092	L
	2021/4/8 7:22	ND(0.0013)	0.0031	O
		ND(0.0015)	0.0025	L
	2021/4/12 7:27	ND(0.0014)	0.0032	O
		ND(0.0014)	0.0037	L
	2021/4/20 7:24	ND(0.0012)	0.0054	O
		ND(0.0014)	0.0099	L
	2021/4/27 7:22	ND(0.0015)	0.0032	O
		ND(0.0014)	0.0052	L
	2021/5/6 7:34	ND(0.0016)	0.0027	O
		ND(0.0015)	0.0037	L
	2021/5/10 7:30	ND(0.0015)	0.0029	O
		ND(0.0014)	0.0034	L
	2021/5/19 7:38	ND(0.0012)	0.0044	O
		ND(0.0015)	0.0093	L
	2021/5/24 7:33	ND(0.0016)	0.0041	O
		ND(0.0014)	0.0041	L
	2021/6/1 7:30	ND(0.0015)	0.0034	O
		ND(0.0015)	0.0049	L
2021/6/7 7:22	ND(0.0018)	0.0029	O	
	ND(0.0016)	0.0086	L	
2021/6/14 7:25	ND(0.0015)	0.0034	O	
	ND(0.0015)	0.0038	L	

O: 上層(表層~2m) Outer Layer
L: 下層(海底より2~3m上) Lower Layer

福島第一原子力発電所沿岸海域の海水採取ポイント
 (Seawater sampling points near and around Fukushima Dai-ichi NPP)

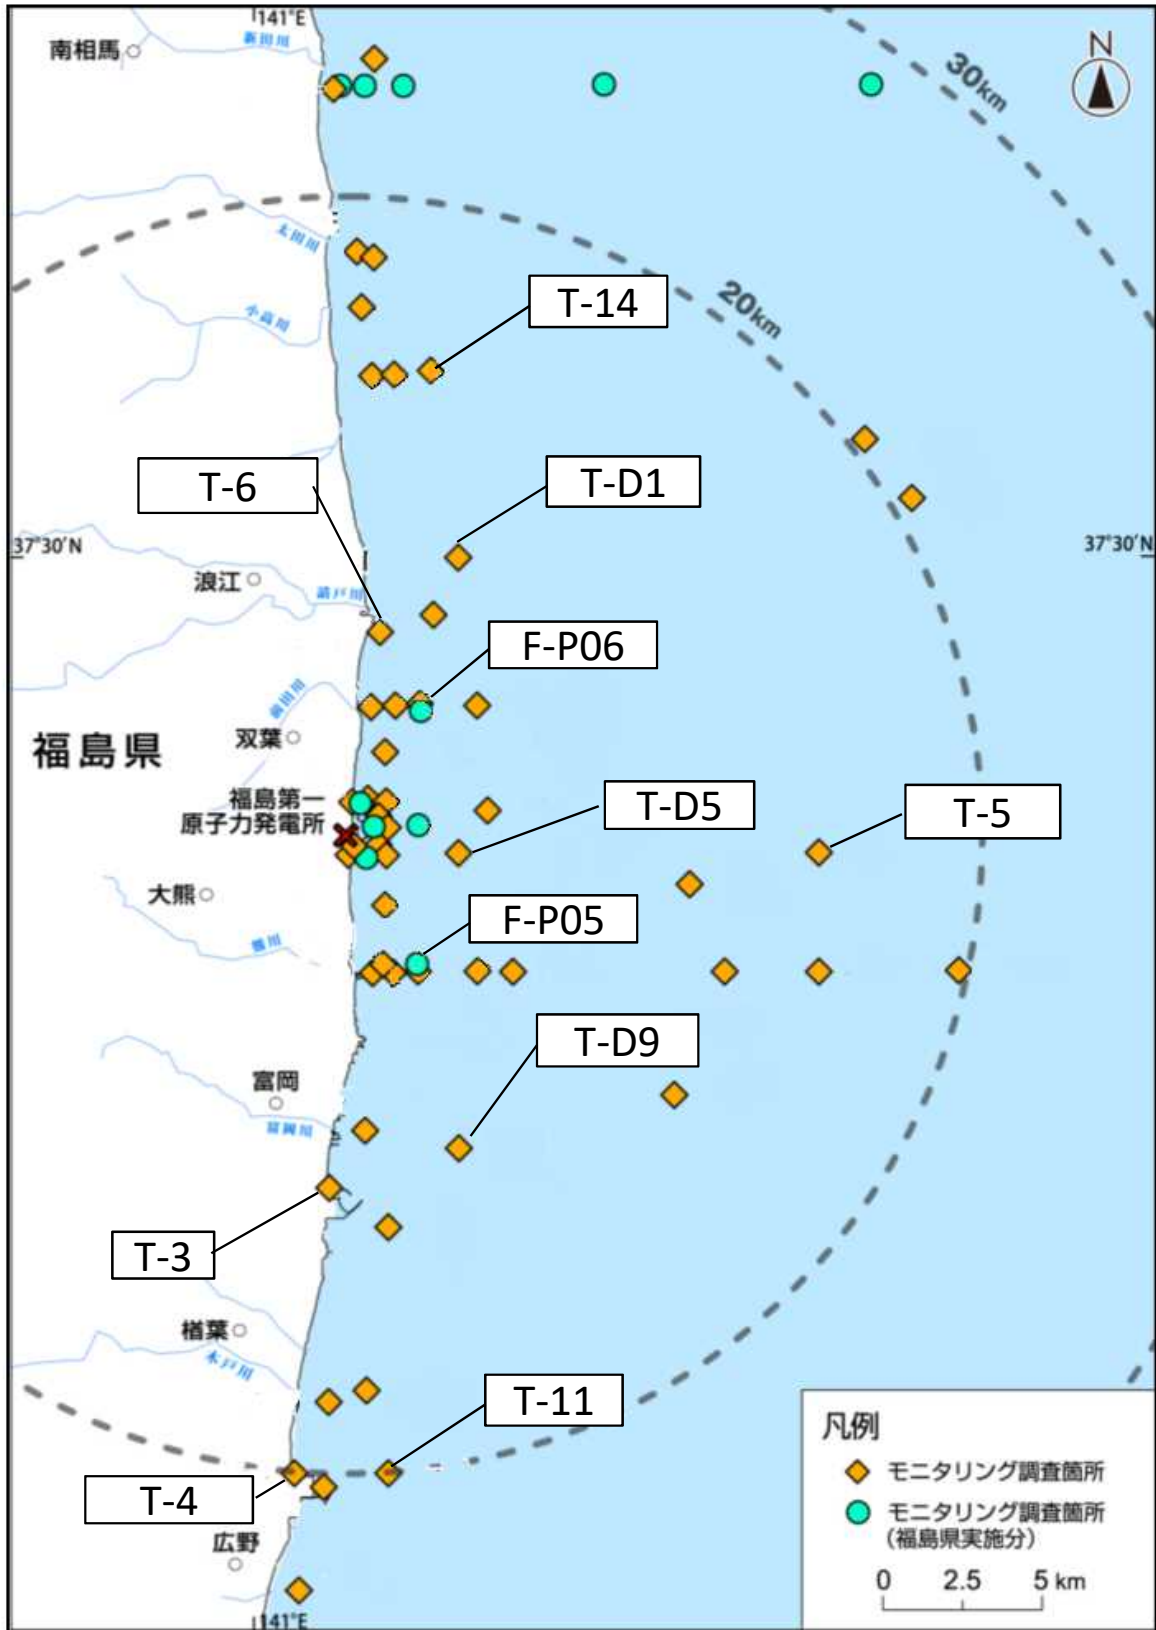

* 図中の×は東京電力ホールディングス(株)福島第一原子力発電所を示す。
 * The legend × indicates the location of TEPCO Fukushima Dai-ichi NPP.